



TECHNICAL DATA



J-1 WET ALARM VALVE WITH EUROTTRIM FOR DUTCH MARKET

Viking SupplyNet BV, Hinmanweg, 11, NL-7575 BE Oldenzaal, The Netherlands
Telephone: +31-541-573233 Fax: +31-541-573234 Email: vikingnetherlands@vikingcorp.com

1. DESCRIPTION

The Viking Model J-1 Alarm Check Valve serves as a check valve by trapping pressurized water above the clapper and preventing reverse flow from sprinkler piping. The valve is designed to initiate an alarm during a sustained flow of water (such as the flow required by an open sprinkler) by operating an optional water motor alarm and/or alarm pressure switch. The valve is made suitable for use on variable pressure water supplies by adding the optional retard chamber to the standard trim.

2. LISTINGS AND APPROVALS

-  **cULus Listed**
-  **FM Approved**
-  **CE Certified**



3. ORDERING INFORMATION

To order a Viking Eurotrim follow our three step selection process:

TABLE 1: VALVE SIZES AND END CONNECTIONS							
Step 1: Base Valve & Trim	End Connections	End Connection Types	3"	4"	6"		8"
			DN80 89 mm	DN100 114 mm	DN150		DN200 219 mm
					165 mm	168 mm	
Flange-Flange	ANSI		ET08235	ET08238	ET08241		ET08244
	PN10		ET09108	ET09109			ET09111
	PN16						ET12388
Flange-Groove	ANSI		ET08236	ET08239	--	ET08242	ET08245
	PN10		ET09535	ET09536	--		ET09877
	PN16				ET12389		
Groove-Groove	--		ET08237	ET08240	ET09405	ET08243	ET08246



TABLE 2: ALARM TRIM		
Step 2: Alarm Trim	Part Number	
	Approval Type	
	19421	
	Dutch Market	



TABLE 3: OPTIONAL COMPONENTS			
Step 3: Optional Components	Part Number		
	Component		
		05904B	
		Retard Chamber	
	880214		
	Monitoring Switch for Alarm Line Ball Valve		
	8121960050		
	Bracket for Monitoring Switch		




TECHNICAL DATA

J-1 WET ALARM VALVE WITH EUROTRIM FOR DUTCH MARKET


Viking SupplyNet BV, Hinmanweg, 11, NL-7575 BE Oldenzaal, The Netherlands
Telephone: +31-541-573233 Fax: +31-541-573234 Email: vikingnetherlands@vikingcorp.com

4. DIMENSIONS

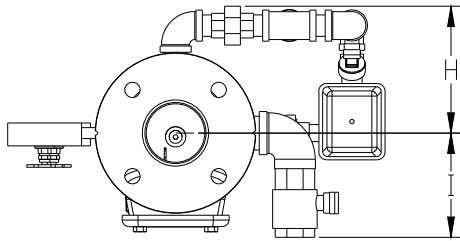

Size	A	B	C	D	E	F	G	H	I
3" DN80	258.8	184.2	220.0	209.5	261.3	200.9	190.9	158.5	130.2
4" DN100	269.9	187.3	241.0	221.6	282.3	191.0	192.4	161.1	180.2
6" DN150	339.7	257.2	243.2	244.4	284.4	137.4	246.1	185.9	180.2
8" DN200	431.8	211.1	285.7	269.8	327.0	75.5	169.9	211.3	180.2

All dimensions are approximations.

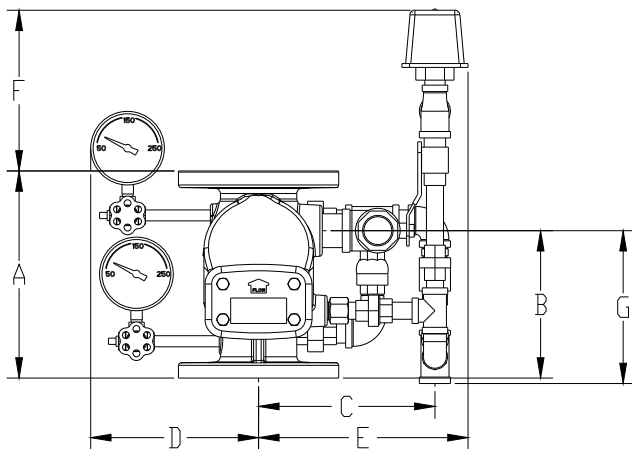

5. MOUNTING INSTRUCTIONS

1. Attach the gauges and their spigots to the valve (1)
2. Attach the base trim to the valve by tightening the three unions (2)
3. Attach the alarm trim to the base trim by tightening the union (3)
4. If a retard chamber is required the remove the $\frac{1}{2}$ " x $\frac{3}{4}$ " reducer from the alarm line (4) and insert the retard chamber. The reducer has been installed with PTFE tape to allow for easy removal.

